


STANDARD SPRINKLER RISER
DETAIL W-15

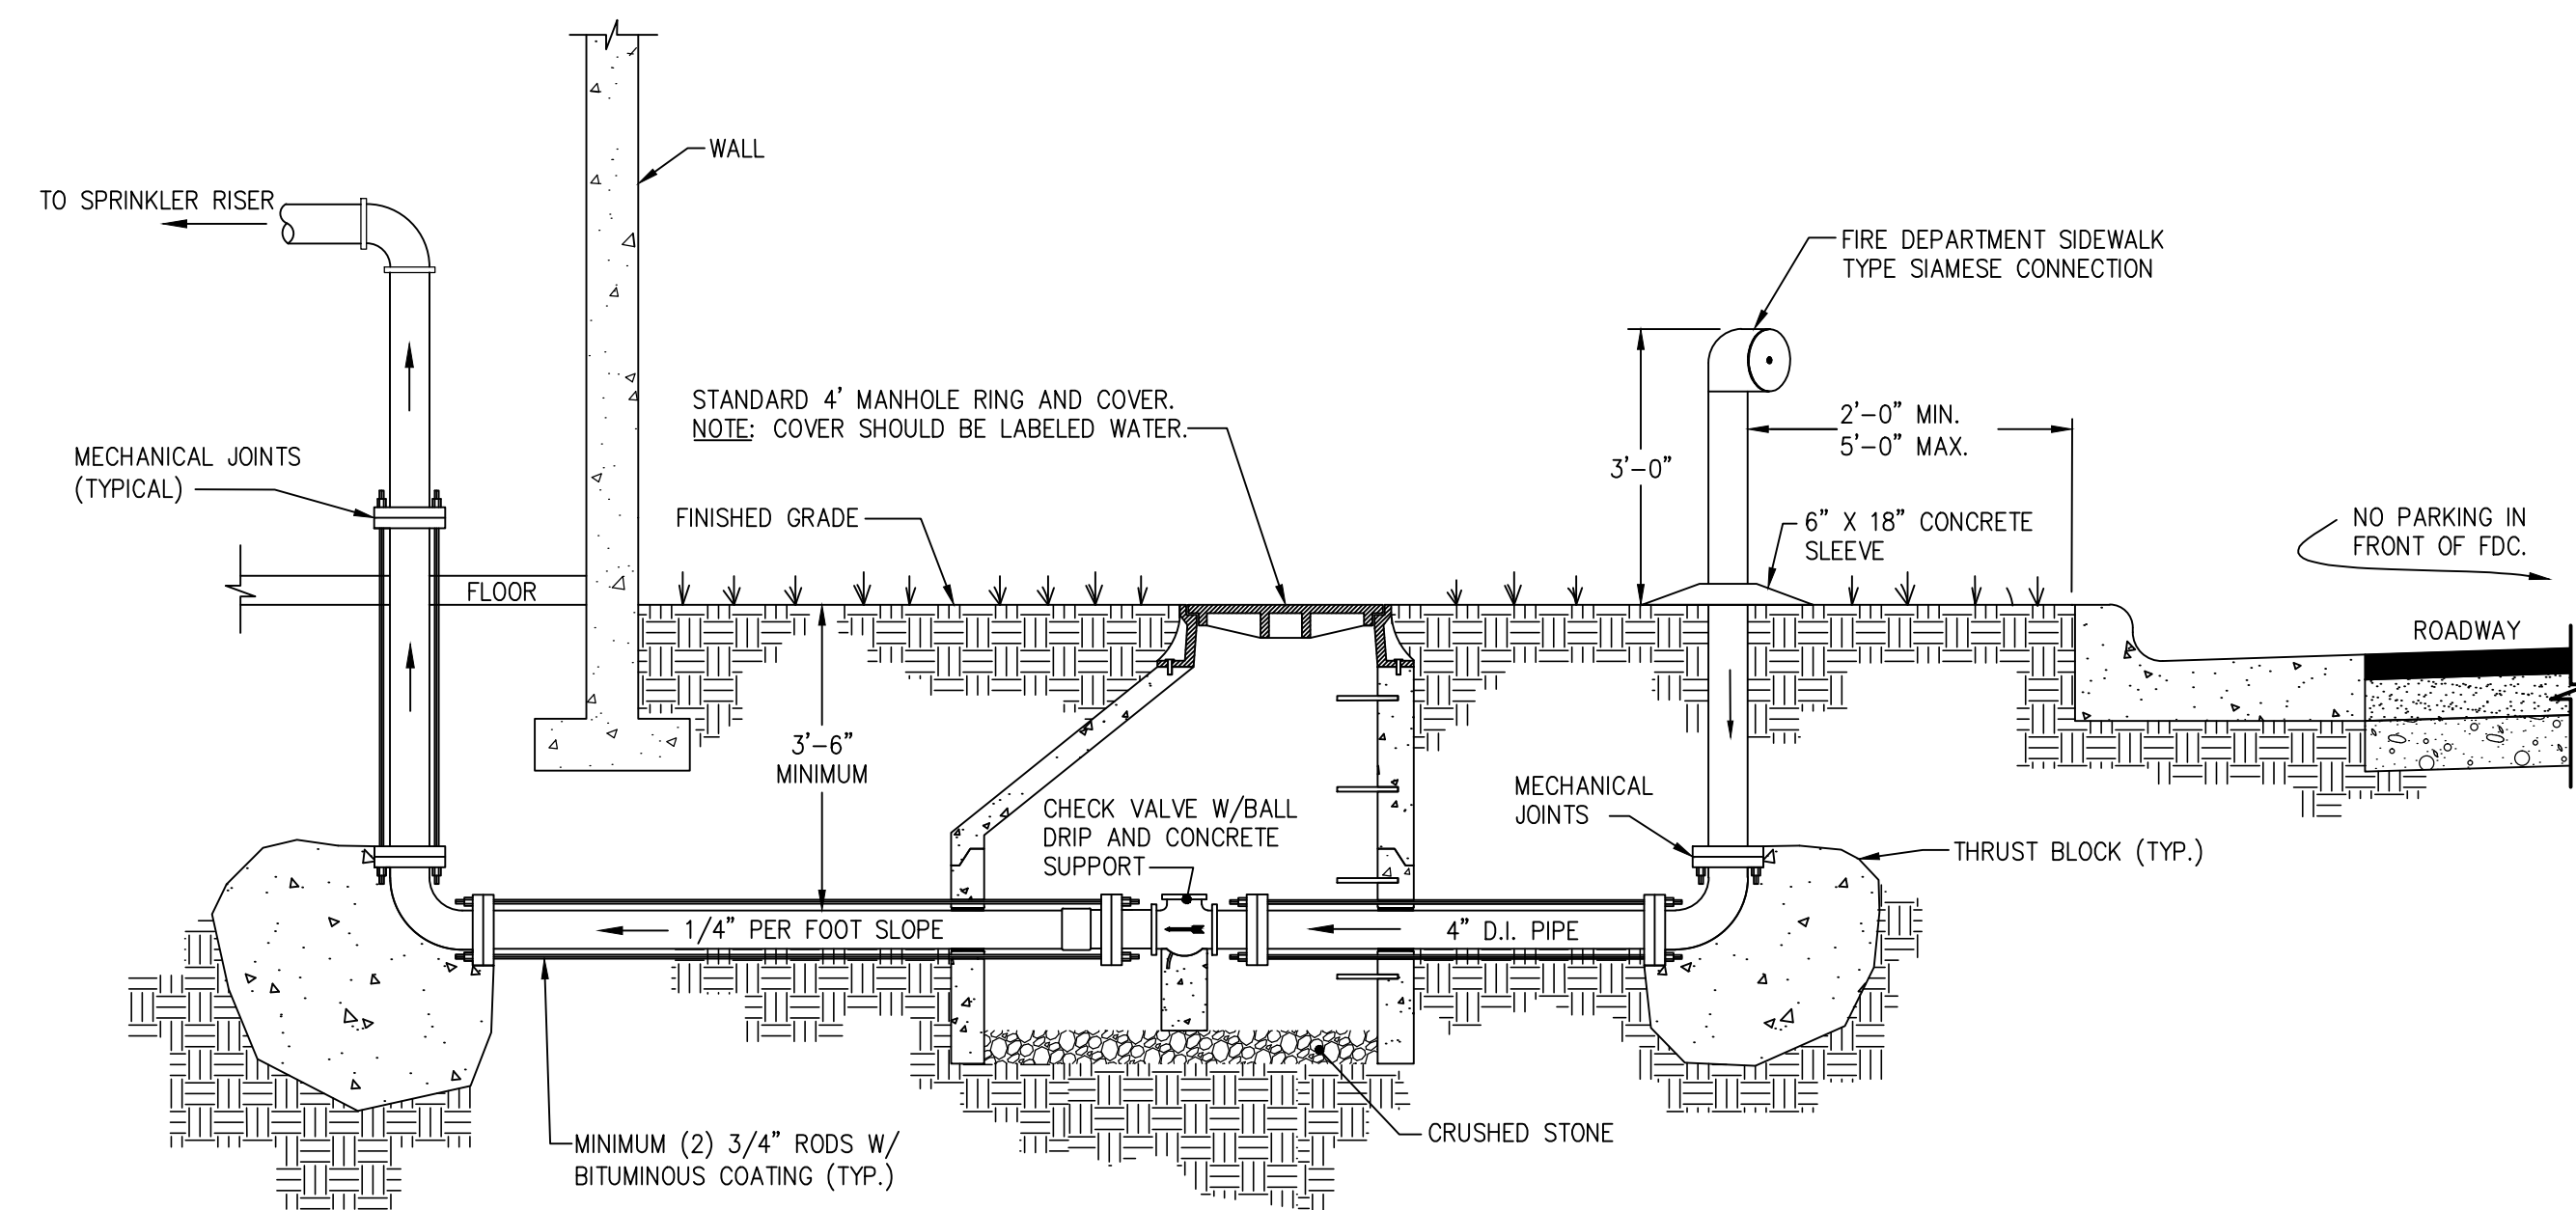


NOTES:

- 1) ALL SIAMESE CONNECTION'S MUST BE WITHIN 50 FEET OF A FIRE HYDRANT OR APPROVAL OTHERWISE BY THE FIRE MARSHALL.
- 2) SIAMESE CONNECTION CAN BE ATTACHED TO BUILDING. CHECK VALVE W/ BALL DRIP NOT REQUIRED IF SIAMESE CONNECTION IS TIED DIRECTLY TO THE BUILDING.

CURB SIDE FIRE DEPARTMENT CONNECTION
DETAIL W-16

Revisions

COUNTY OF BRUNSWICK



GENERAL WATER DETAILS
FOR
BRUNSWICK COUNTY
NORTH CAROLINA

Date: 06-05-12

Scale: NTS

Drawn By: JDM

Checked By: WLP